



Connection diagram

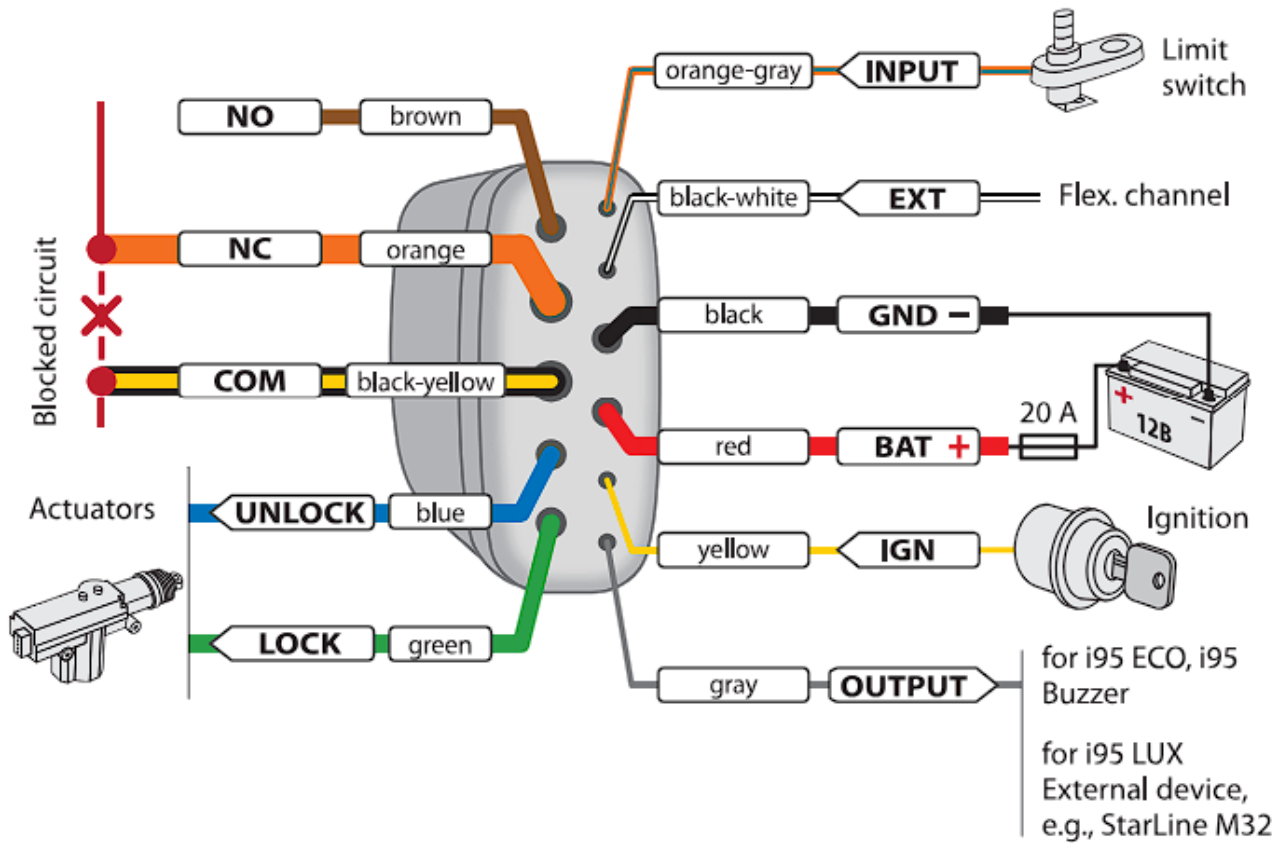

The device is supplied with text and color markings

Diagram of external outputs

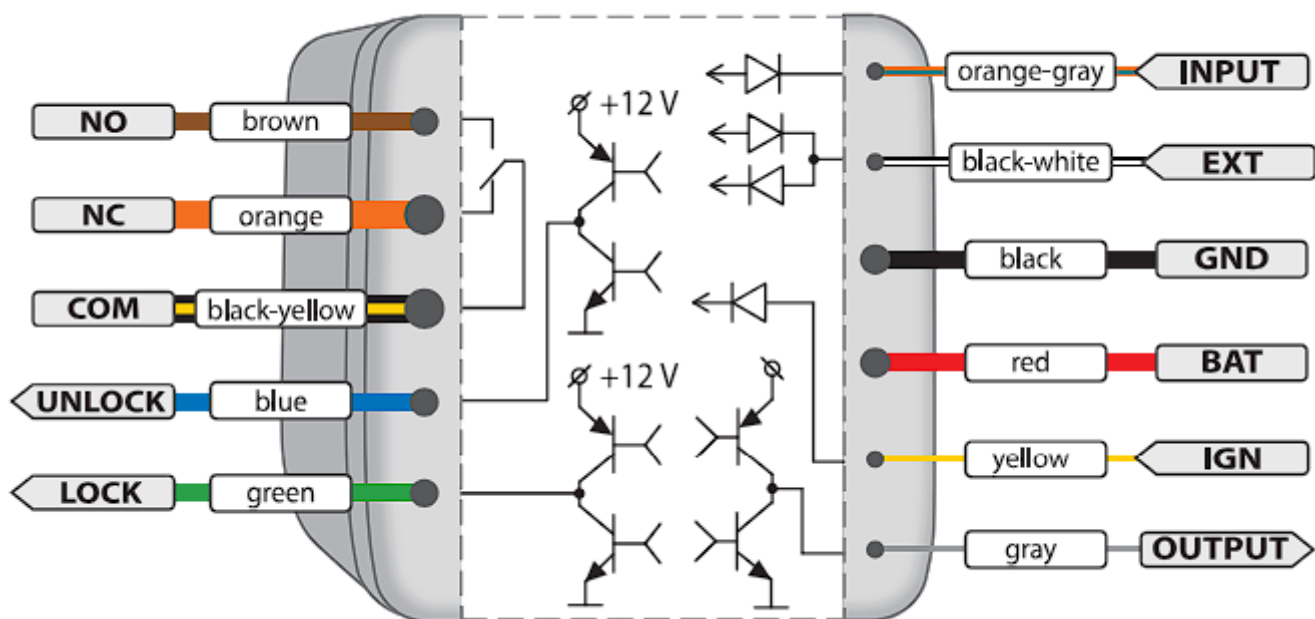

Designation of external outputs

All blocking module wires are marked white.

Marking	Designation
GND	Ground (-)
BAT	Power supply (+)
IGN	Ignition
NO	Normally open relay contact
NC	Normally closed relay contact
COM	Common relay contact
UNLOCK	Opening the door lock (or hood lock)
LOCK	Closing the door lock (or hood lock)
INPUT	Input the door (or hood) limit switch
OUTPUT	i95 ECO, i95 - buzzer output i95 LUX - status output
EXT	Flexible channel

Версия #2

Admin создал 20 мая 2024 15:58:35

Admin обновил 20 мая 2024 16:15:48